

## WALL MOUNT HORN/STROBES

## FHS-340 SERIES



### Description

The FHS-340 Horn/Strobe Series provides a wide range of candela light output options in a single device. The candela settings include a 12 or 24 volt DC operation for the 15, 35 and 60 (75 on axis) candela settings and 24 volt DC operation for the 15, 35, 60, 75, 95 and 110 candela settings. The candela setting is displayed through the front window and is selectable using a drum wheel.

The horn settings include Temporal, Non-Temporal, March Time and a Chime sound. The horn also has Low, Mid and High volume settings for each pattern and tone. The tones include 2400 Hz, Electro-Mechanical, Broadband and Chime.

The voltage input can be either regulated DC or full wave rectified (FWR) 12 volt or 24 volt operation with an operating range from 8 to 33 V DC. The strobes can be synchronized using a control panel with the Mircom (Amseco) sync protocol or an SDM-240 sync module.

The FHS-340 utilizes a universal mounting plate that will mount on a single gang, double gang, octagon and 4" square electrical boxes. The back plate allows the installer to mount the plate and connect the wire connections. The strobe attaches in a hinge fashion from the top and is secured by a single mounting screw. The strobe completely covers the mounting back plate, therefore it can be mounted before other trades work is completed and not affect the final look.

### Features

- UL and C-UL listed
- 12 VDC with 15, 35 or 60 cd settings
- 24 VDC with 15, 35, 60, 75, 95 or 110 cd settings
- 6 distinct candela settings
- Candela selection view window
- 15/75 ADA compliant on 60cd setting
- 33 sound output settings
- Horn or chime sound output
- Pre-wire back plate
- Universal back plate mounting (single gang, double gang, octagon, or 4" square)
- Single screw mounting
- For indoor applications

### Engineering Specifications

The installer shall provide and install the FHS-340 selectable horn/strobe. The strobe shall have six (6) candela settings. The candela settings shall be selectable using a drum roller and shall display the candela setting on the front of the device. The horn shall have 33 selectable settings configurable by dip switches. The sounder shall be capable of ANSI Temporal Code 3, March Time and produce a chime output. The horn shall have three distinct volume levels. The horn/strobe shall operate at 12 or 24 VDC regulated or full wave rectified. The horn/strobe shall have an operating range between 8 and 33 VDC. The strobes can be synchronized using a control panel with the Mircom sync protocol or the SDM-240 sync module. The strobe shall utilize a mounting plate that allows the installer to pre-wire the mounting plate. The mounting plate shall be universal and mount on a single gang, double gang, octagon or 4 inch square box. The mounting plate shall be completely covered by the strobe and shall be secured by a single screw. The strobe shall be UL listed to standard 1638, General Signaling, and standard 1971, Signaling Devices for the Hearing Impaired. In addition, the strobes shall be C-UL listed to CAN-ULC S526. The horn shall be UL listed to standard 464, Audible Signaling Devices.



CATALOG NUMBER **5269**

NOT TO BE USED FOR INSTALLATION PURPOSES.


Mircom reserves the right to make changes at any time without notice in prices, colours, materials, components, equipment, specifications and models and also to discontinue models.

## Installation

### CAUTION


A jumper plug is provided to test for correct wiring in the supervisory mode only. Do not pass alarm current through the jumper.

**Note:** Installation must comply in accordance with applicable standards.

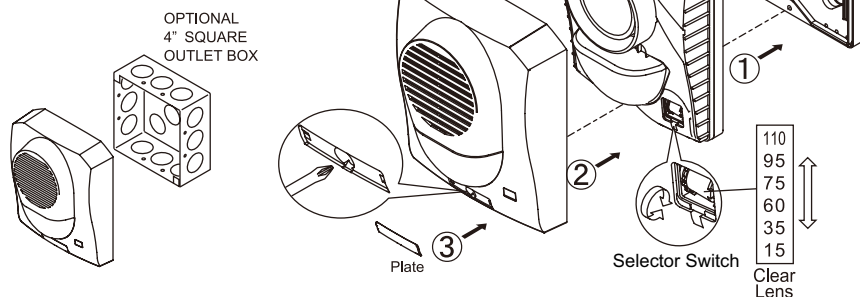

## Dimensions

Inches (mm)

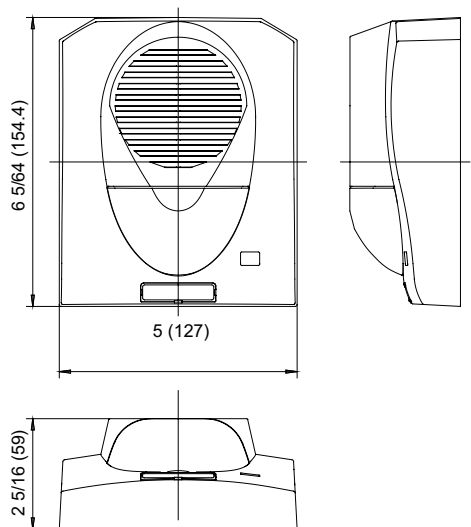


## Light Output


Light output in percentage when measured from the following directions per UL 1971.

Wall and ceiling mount horizontal dispersion

Ceiling mount vertical dispersion



Wall mount vertical dispersion



Degrees	% of Rating	
	Horizontal	Vertic
0	100	100
5~25	90	90
30	75	90
35	75	65
40	75	46
45	75	34
50	55	27
55	45	22
60	40	18
65	35	16
70	35	15
75	30	13
80	30	12
85~90	25	12

### WARNING

High voltage may be present inside the light assembly even though power is not connected. If access to the component board is required (removal or replacement), the capacitor must be discharged by touching a wire to both ends of the flash tube.

DO NOT attempt to touch or move the assembly until the capacitor has been discharged.

## Specifications

### Strobe Current

Light Output	Max. RMS Operating Current (mA RMS)			
	Reg. 12 VDC	Reg. 12 FWR	Reg. 24 VDC	Reg. 24 FWR
15cd	116	152	62	99
35cd	209	267	102	152
60/75cd	254	258	131	190
75cd	NA	NA	146	208
95cd	NA	NA	177	243
110cd	NA	NA	196	268

<b>Voltage</b>	12/24V	
<b>UL Designation</b>	Regulated 12 DC/FWR	Regulated 24 DC/FWR
<b>Operating Voltage Range</b>	8 - 17.5V	16 - 33V
<b>Flash Rate</b>	60 times/min.	
<b>Sync Module (SDM-240)</b>	N/A	Available
<b>Operating Temperature Range</b>	Indoor model: 32°F to 120°F (0°C to 49°C)	

## Dipswitch Settings

### Horn Dipswitch

#### Pattern

1 ON - Non-temporal

1 OFF - Temporal

Both 2 = OFF

1 and 2 ON = March Time

#### Tone

3 and 4 ON = 2400Hz

3 ON and 4 OFF = Electromechanical

3 and 4 OFF = Chime

3 OFF and 4 ON = Broadband

#### Volume


5 and 6 ON = High

5 ON and 6 OFF = Mid

5 and 6 OFF = Low

7 and 8 ON = Horn/strobe on 2 wires

7 and 8 OFF = Horn and strobe on 4 wires



## Specifications

### Non-Temporal Horn Current

Pattern	Volume	Max. RMS Operating Current (mA RMS Current)				dBA Reverberant Ratings per UL464 (dBA @ 10 ft.)		dBA Anechoic Ratings per CAN/ULC S525 (dBA @ 10 ft.)	
		Reg 12 VDC	Reg 12 FWR	Reg 24 VDC	Reg 24 FWR	Reg 12 VDC/FWR	Reg 24 VDC/FWR	Reg 12 VDC/FWR	Reg 24 VDC/FWR
2400 Hz	High	119	79	87	125	87	87	99	100
	Mid	44	46	28	74	82	82	94	96
	Low	30	30	18	41	79	80	92	92
Electro-Mechanical	High	118	77	81	121	86	87	100	100
	Mid	43	43	26	67	82	84	96	97
	Low	27	29	16	36	79	80	93	93
Broadband	High	146	125	78	148	86	86	101	102
	Mid	41	63	26	64	81	82	96	98
	Low	28	40	16	39	77	79	94	95
Chime	High	27	35	21	27	70	70	86	86
	Mid	11	15	8	13	62	62	79	80
	Low	9	11	7	12	58	57	75	75

### Temporal Horn Current


Pattern	Volume	Max. RMS Operating Current (mA RMS Current)				dBA Reverberant Ratings per UL464 (dBA @ 10 ft.)		dBA Anechoic Ratings per CAN/ULC S525 (dBA @ 10 ft.)	
		Reg 12 VDC	Reg 12 FWR	Reg 24 VDC	Reg 24 FWR	Reg 12 VDC/FWR	Reg 24 VDC/FWR	Reg 12 VDC/FWR	Reg 24 VDC/FWR
2400 Hz	High	124	70	87	132	82	82	100	100
	Mid	46	38	30	83	77	79	95	96
	Low	30	28	18	36	74	75	92	92
Electro-Mechanical	High	114	69	80	134	83	82	100	101
	Mid	42	40	27	67	78	80	95	96
	Low	28	27	16	36	75	76	93	93
Broadband	High	151	117	80	146	82	82	101	102
	Mid	45	59	26	73	77	78	97	98
	Low	30	42	16	31	75	76	94	95
Chime	High	29	35	21	28	68	70	86	86
	Mid	10	17	9	12	61	61	79	79
	Low	9	12	8	9	55	55	75	76

### March Time Horn Current


Pattern	Volume	Max. RMS Current (mA RMS Current)				dBA Reverberant Ratings per UL464 (dBA @ 10 ft.)		dBA Anechoic Ratings per CAN/ULC S525 (dBA @ 10 ft.)	
		Reg 12 VDC	Reg 12 FWR	Reg 24 VDC	Reg 24 FWR	Reg 12 VDC/FWR	Reg 24 VDC/FWR	Reg 12 VDC/FWR	Reg 24 VDC/FWR
2400 Hz	High	121	70	92	132	83	84	99	100
	Mid	47	39	31	76	79	81	95	96
	Low	36	25	19	35	76	77	92	92
Electro-Mechanical	High	114	69	86	125	83	83	100	100
	Mid	42	37	27	67	80	81	95	96
	Low	30	26	19	37	77	77	92	93
Broadband	High	153	121	77	126	83	84	101	102
	Mid	42	55	28	56	79	80	97	98
	Low	29	42	16	26	76	77	94	95

## Wiring Diagram


### Horn / Strobe Signal Operate Independently

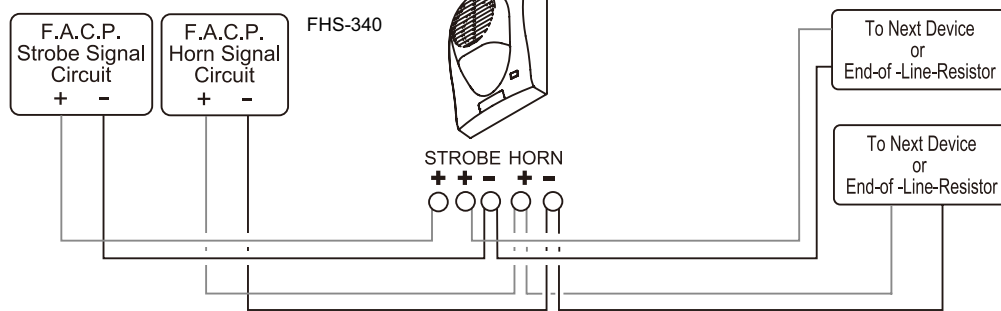

### Horn / Strobe Wiring Diagram for Audible Strobe Class "B" Circuit with Audible Silence Feature. (FHS-340)

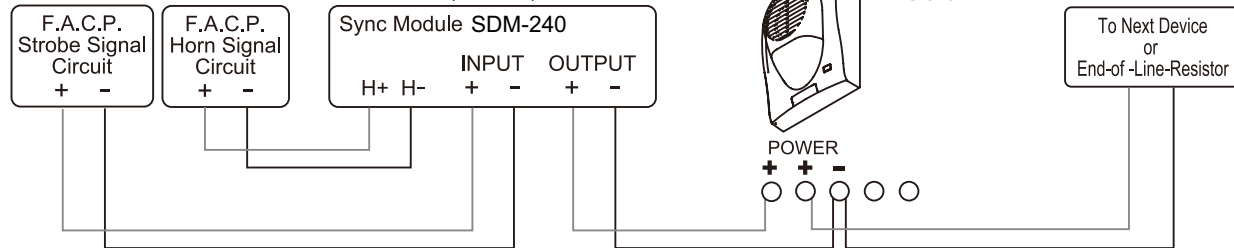

### Horn or Strobe Wiring Diagram for Audible Strobe Class "B" Circuit without Audible Silence Feature.

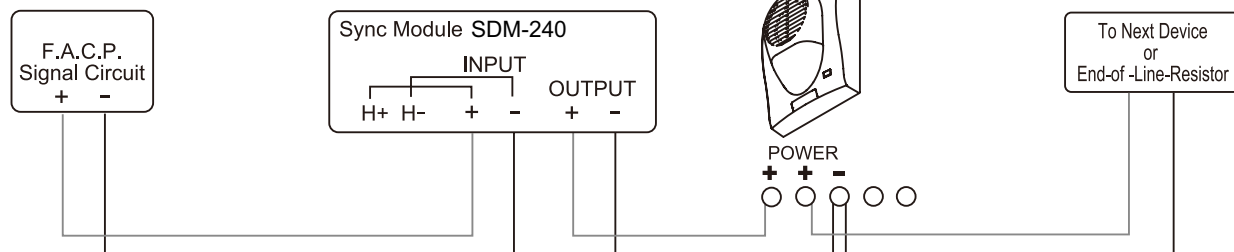

Refer to the SDM-240 Sync Module instruction manual for Class "A" wiring or other application diagrams.

## Ordering Information

Model Number	Description
FHS-340R	Wall Mount Horn/Strobe, Red
FHS-340W	Wall Mount Horn/Strobe, White

NOT TO BE USED FOR INSTALLATION PURPOSES.



#### Canada

25 Interchange Way  
Vaughan, Ontario L4K 5W3  
Telephone: (905) 660-4655  
Fax: (905) 660-4113

#### U.S.A.

4575 Witmer Industrial Estates  
Niagara Falls, NY 14305  
Toll Free: (888) 660-4655  
Fax Toll Free: (888) 660-4113

Web page: <http://www.mircom.com>

Email: [mail@mircom.com](mailto:mail@mircom.com)

Distributed by:

ISO 9001:2008  
REGISTERED



CAT. 5269  
Rev. 1